

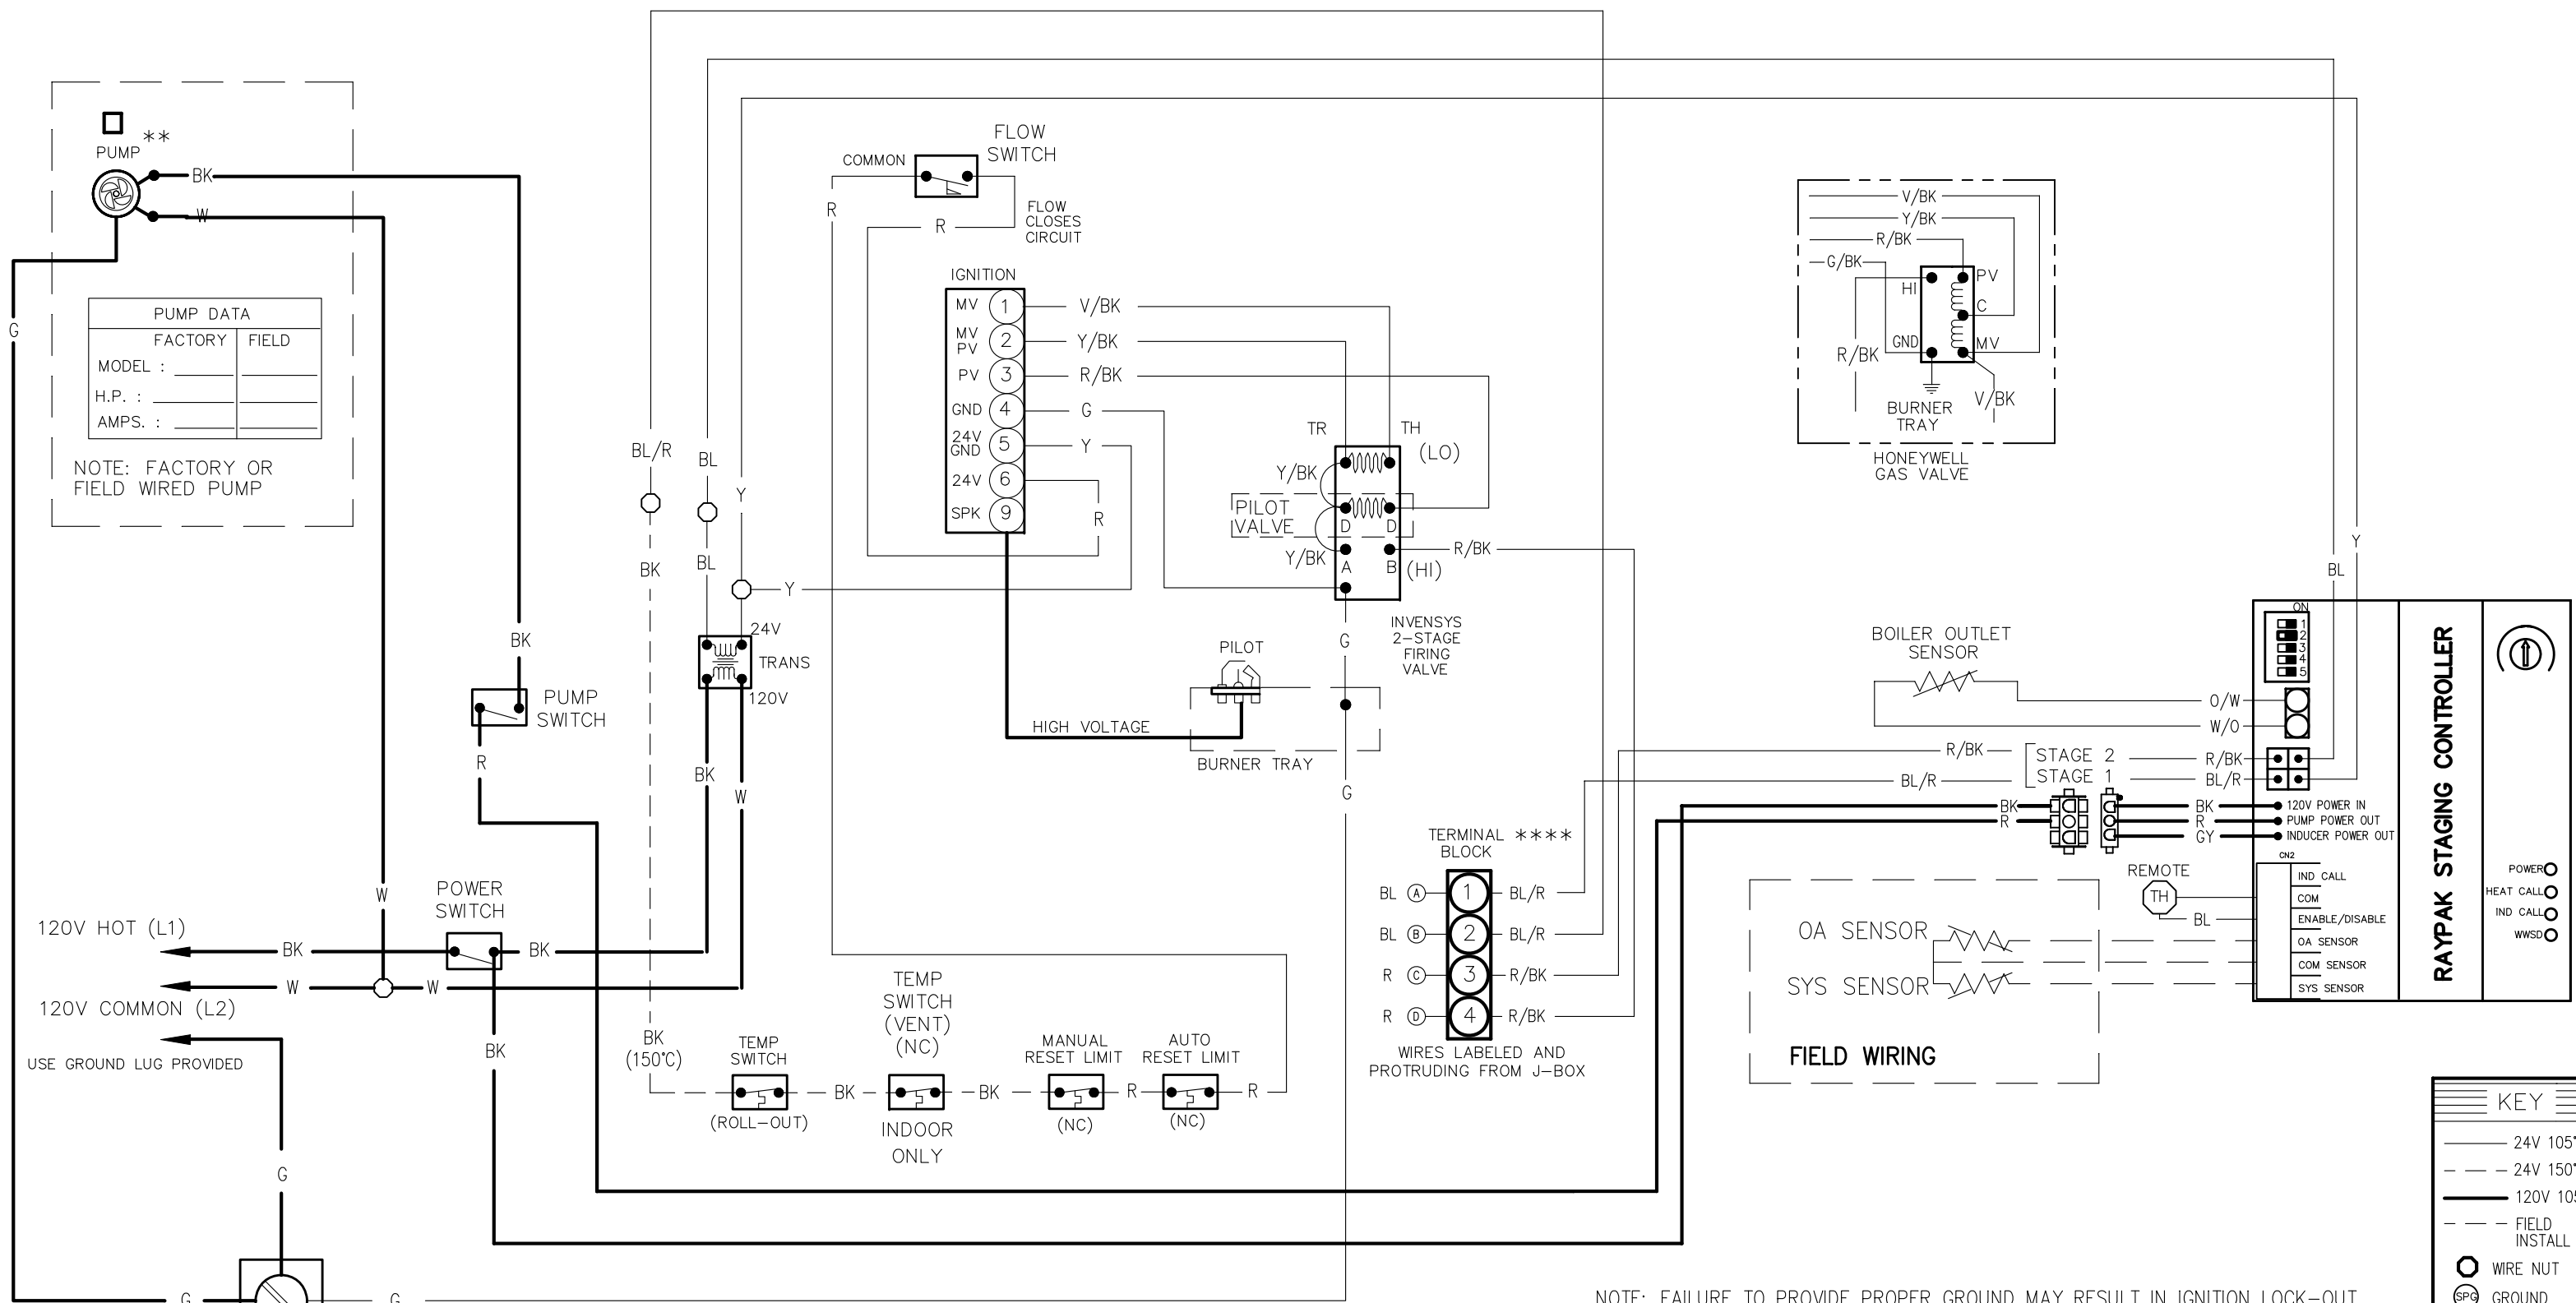
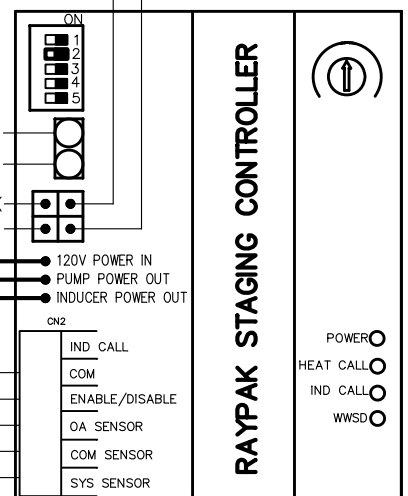
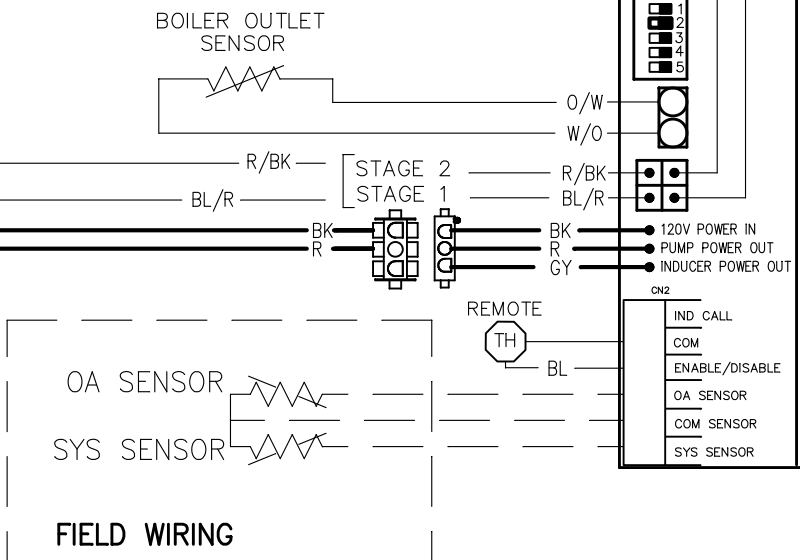
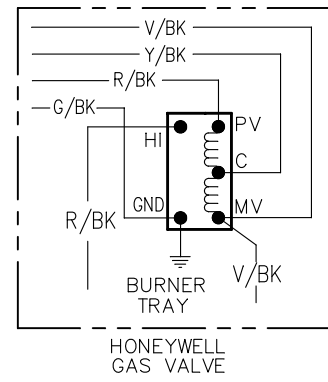
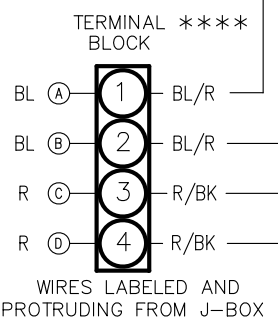
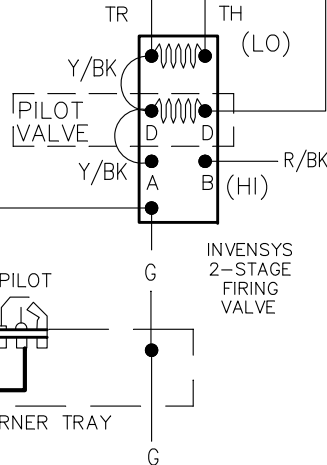



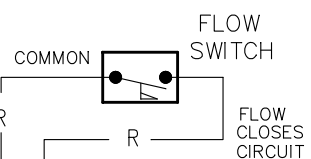

PUMP DATA	
FACTORY	FIELD
MODEL :	
H.P. :	
AMPS. :	

NOTE: FACTORY OR
FIELD WIRED PUMP

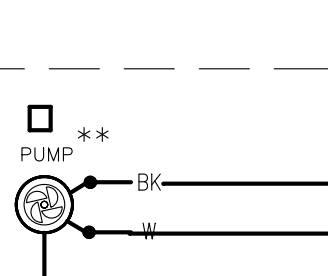

KEY	
—	24V 105°C
- - -	24V 150°C
—	120V 105°C
- - -	FIELD INSTALL
○	WIRE NUT
⊕	GROUND
⊕	THERMOSTAT
BK	BLACK
BR	BROWN
R	RED
O	ORANGE
Y	YELLOW
G	GREEN
BL	BLUE
V	VIOLET
W	WHITE

NOTE: FAILURE TO PROVIDE PROPER GROUND MAY RESULT IN IGNITION LOCK-OUT.

CHECKED BY:	NOTES: * REPLACE WIRING WITH 105°C OR 150°C AS NOTED. ** PUMP MOTOR RATING NOT TO EXCEED 5 AMPS OR 1/3 HP.		
APPROVED BY:			
ORIG E.O. 3597	WIRING DIAGRAM IID / (S8600 or 8610) / ECONOMASTER FIRING MODE: TWO STAGE W/ WIRES MARKED AND TAGGED EXTENDING OUT OF J-BOX		
DATE: 07/11/05			
CHG E.O. 4986	HURON VALLEY SALES		
DATE: 10/17/12			
PROPAK	BOILER SIZE: 918-926	BOILER TYPE: WT2	DIAGRAM NO. 152924 3