



SUBMITTAL COVER SHEET

PROJECT NAME _____

LOCATION _____

ARCHITECT _____

ENGINEER _____

CONTRACTOR _____

SUBMITTED BY _____ DATE _____



UNIT SUMMARY

Quantity						
Unit Designation						
Model No.						
Total Cooling						
Sensible Cooling						
Air Ent. Evaporator						
Air Lvg. Evaporator						
Heating Input						
Heating Output						
CFM/ESP						
EER/SEER						
Electrical						
Minimum Ampacity						
Min.-Max. Breaker						
Net Unit Weight						
Accessory						
Catalog Form Number						

ACCESSORIES:

NOTES:

UPFLOW MODELS

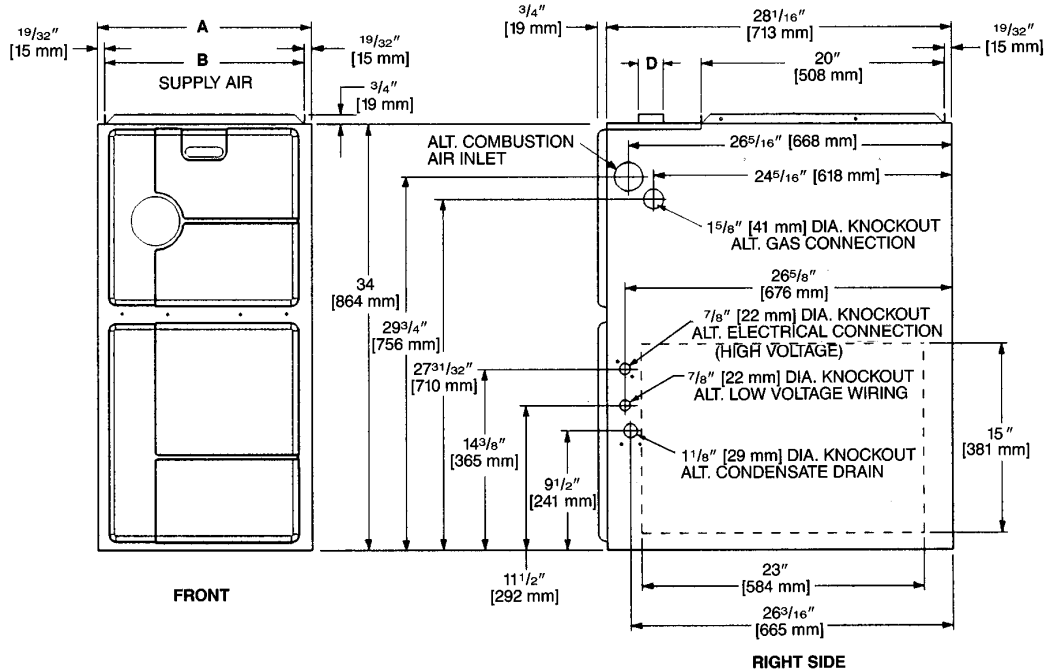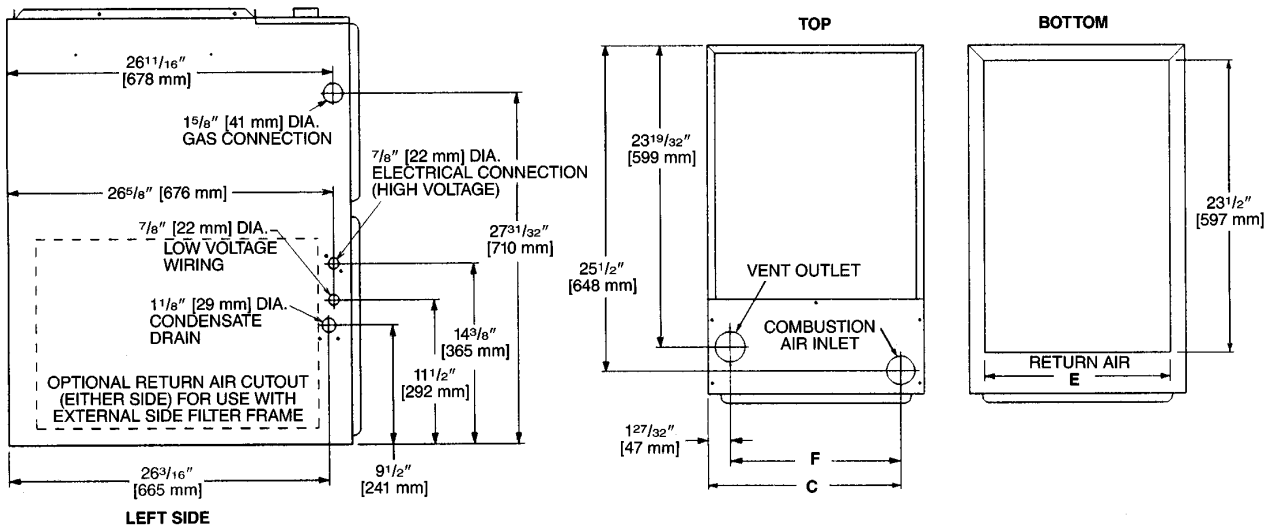

MODEL (-)GRA- (-)GRJ-	A	B	C	D	E	F	LEFT SIDE	MINIMUM CLEARANCE (IN.) [mm]					SHIP WGTS. [kg]
								RIGHT SIDE	BACK	TOP	FRONT	VENT	
04*M	17 1/2 [445]	16 11/32 [415]	15 5/8 [397]	2 [51]	15 [422]	13 25/32 [352]	0	0	0	1 [25]	2 [51]	0	111 [50]
06*M	17 1/2 [445]	16 11/32 [415]	15 5/8 [397]	2 [51]	15 [422]	13 25/32 [352]	0	0	0	1 [25]	2 [51]	0	117 [53]
07*M	17 1/2 [445]	16 11/32 [415]	15 5/8 [397]	2 [51]	15 [422]	13 25/32 [352]	0	0	0	1 [25]	2 [51]	0	123 [56]
07*Y	21 [533]	19 27/32 [504]	19 1/8 [487]	2 [51]	18 1/2 [511]	17 9/32 [441]	0	0	0	1 [25]	2 [51]	0	123 [56]
09*Z	21 [533]	19 27/32 [504]	19 1/8 [487]	2 [51]	18 1/2 [511]	17 9/32 [441]	0	0	0	1 [25]	2 [51]	0	148 [67]
10*Z	21 [533]	19 27/32 [504]	19 1/8 [487]	2 [51]	18 1/2 [511]	17 9/32 [441]	0	0	0	1 [25]	2 [51]	0	152 [69]
12*R	24 1/2 [622]	23 11/32 [593]	22 5/8 [575]	2 [51]	22 [600]	20 25/32 [530]	0	0	0	1 [25]	2 [51]	0	160 [73]

[] Designates Metric Conversions

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

RHEEM
MANUFACTURING
COMPANY
P.O. Box 17010, Fort Smith, Arkansas 72917-7010

"In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice."